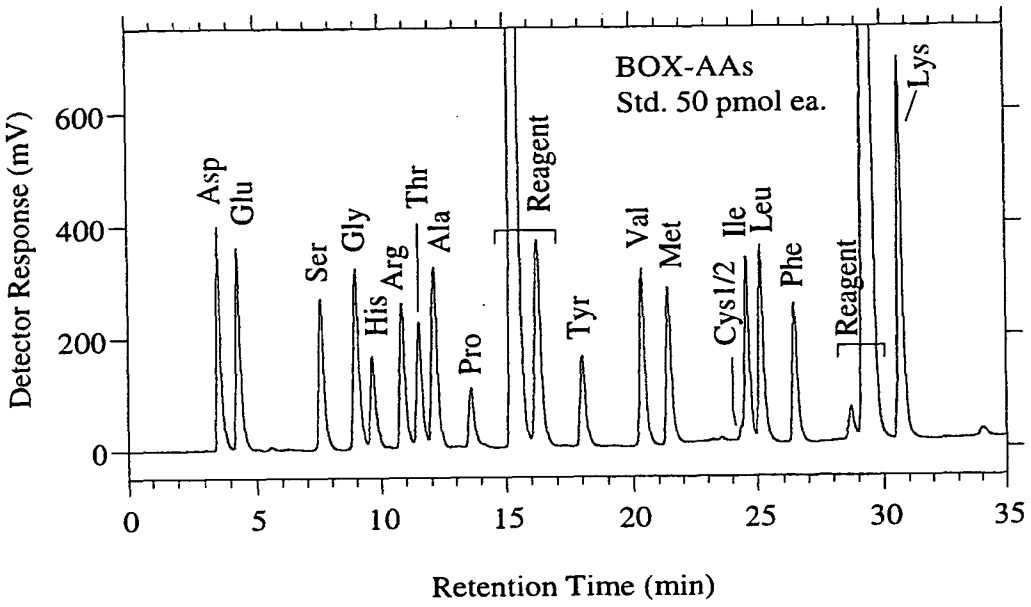
BOX-AAs
Std. 50 pmol ea.
Detector Response (mV)
600
400
200
0
Asp
Glu
Ser
Gly
His
Arg
Thr
Ala
Pro
Reagent
Tyr
Val
Met
Cys1/2
Ile
Leu
Phe
Reagent
Lys
0
5
10
15
20
25
30
35
Retention Time (min)

FIGURE 1